

### **Digital Over Current Relay**







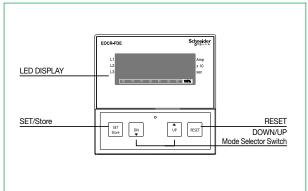

#### **Main Features**

- Built-in MCU (Micro Controller Unit)
- Real Time Processing/Higher Precision
- Over Current Protection Range: 0.5~60A, Wide Range Protection (with an external CT, 1~960A)
- Under Current Protection Range : The set over current or less
- Operation Time Characteristics: Definite 0.5~60A (external CT combination for 60A or higher), Inverse 0.5~10A (use an external CT combination for 11A or higher)
- Under Current Trip Output
- Under Current output is set to be shared with the OC output in the factory default settings. However, if "U" is selected in "ALo" Mode, "AL" Mode automatically switches to oFF(--) and ALoutput (07-) H08) automatically converts to output contact for under current (UC).
- Digital Display
- 3-phase Current Auto Circulation Display: Digital Ammeter (every 5 sec for each phase) / fixed display on 1 phase by manual circulation
- Trip Cause Digital Display: Easy Troubleshooting
- Last Trip Cause Check Function: Can check the last 3 trip causes and current at the occurrence of each trip. Available even during the recovery of electricity after a power outage.
- Manual (instant)/electrical (remote) reset
- Fail Safe function (FS:ON)
- Self-diagnosis function
- When power is supplied to the relay, the relay is normally energized if it is in a normal condition (selectable in setting)
- $\bullet$  Can be applied in various installation environments, with both terminal and hole types available
- Works well with a frequency converting device system such as an inverter: Frequency contingency range of 20~400Hz

#### **Protection Functions and Characteristics**

Protection Function		Operation Time
Over Current		Operates based on the set ot
Under Current		Operates based on the set ut
Phase Loss		Within 3 sec
Reverse Phase		0.1~0.3 sec
Unbalance		Within 8 sec
Looked Dates	Lock	Operates within 0.5 sec after dt (Definite operation)
Locked Rotor	Stall	0.5, 1~10 sec (Definite operation)

# **Digital Over Current Relay**

# **Specifications**

Functions and Characteristics			Specifications		
	Over Current		Refer to current setting range table		
Current Setting	Under Current		0.5~59A / oFF (with an external CT : 800A or less)		
	Unbalance		5%~50% (Phase current unbalance ratio) / oFF		
Time Setting	Start Delay Time (dt)		1~200 sec (Definite), 0~200 sec (Inverse)		
	Operation Time (ot)		0.5~30 sec (Definite), 1~30 sec (Inverse)		
Reset			Manual (Instant) Reset/Electrical Reset		
	Over Current		Select Definite/Inverse		
Operation Time Characteristic			Refer to the Notes on Current Setting and External CT Combination		
	Under Current		Definite		
Error Tolerance		Current	I<1A:±0.05A, I≥1A:±5%		
EITOI TOIEIRITGE		Time	t≤3s: ±0.2s, t⟩3s: ±5%		
	Temperature	Operation	-20℃~60℃		
Usage Environment		Save	-30℃~80℃		
	Humidity		30~85% RH (with no dew condensation)		
	Terminal type		AC220/110V		
	теттіінаі туре		- DC/AC85~250V, 50/60Hz		
Operating Power Supply	Hole type		- AC220V: ±15%, 50/60Hz		
			- AC110V: ±15%, 50/60Hz		
			- DC/AC 24V		
Output Contact	OC/UC	2-SPST	AC250V/3A Resistive Load		
Output Contact	AL/UC	1-SPST	AC250V/3A Resistive Load		
Insulation Resistance	n Resistance Between circuit and case		10MΩ or higher at 500VDC		
	Between circuit and o	case	2.0KV 60Hz for 1 min		
Insulation Withstanding Voltage	Between contacts		1.0kV 60Hz for 1 min		
	Between circuits		2.0KV 60Hz for 1 min		
Installation Method			35mm DIN Rail or Panel		

# **Over Current Operation Time Characteristic Curve**

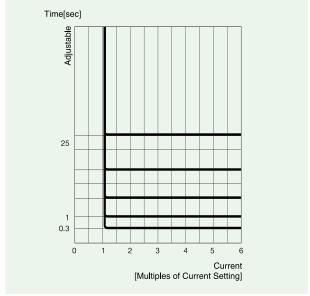


Table 1. Over Current Protection Definite Operation Characteristic Curve

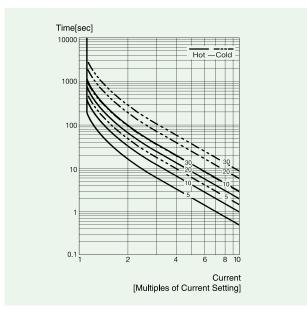


Table 2. Over Current Protection Inverse Operation Characteristic Curve (0.5~10A, external CT combination)

# **Digital Over Current Relay**

# **Current Setting Range Table**

Setting Range	Number of CT Holes	External CT Current Transformer Ratio	CT Setting	Notes	
0.5~60A	1	No CT combination	oFF	Wide Range	
0.25~5.0A	2 Holes	No CT combination	2t		
0.1~2.0A	5 Holes	No CT combination	5t		
1~12A	1	10:05	10		
1.5~18A	1	15:05	15		
2.0~24A	1	20:05	20		
2.5~30A	1	25:05:00	25		
3.0~36A	1	30:05:00	30		
4.0~48A	1	40:05:00	40		
5~60A	1	50:05:00	50		
6~72A	1	60:05:00	60		
7.5~90A	1	75:05:00	75		
10~120A	1	100:05:00	100		
12~144A	1	120:05:00	120		
15~180A	1	150:05:00	150		
20~240A	1	200:05:00	200		
25~300A	1	250:05:00	250		
30~360A	1	300:05:00	300		
40~480A	1	400:05:00	400		
50~600A	1	500:05:00	500		
60~720A	1	600:05:00 600			
75~900A	1	750:05:00	750		
80~960A	1	800:05:00	800		


### **Digital Over Current Relay**


### **Display Front View**

Automatically displays the operating current of 3 phases with the phase display every 5 sec in circulation, without additional button input.

#### • LED Display

#### **EOCR-3DE Type**

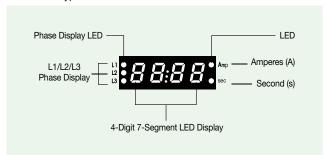

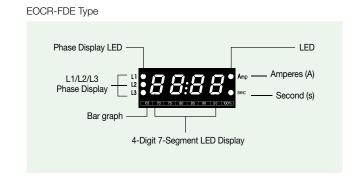


#### 7-segment LED

A large font and a comfortable background color are used to prevent visual interference caused by reflections from the control panel in any direction.

#### Bar graph (for FDE only)

- Allows you to see the load status of the motor by showing the ratio of the present operating current to the set OC (Over Current).
- If you set the OC set value to the rated current of the motor, the percentage (%) shown on the bar graph will indicate the load factor of the motor.

## **3-phase Digital Current System Function**

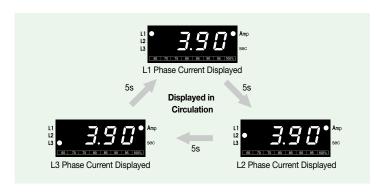

- \*\* Press the SET (Store) button once during operation to view the manual circulation display instead of auto circulation display. Every time you press the SET (Store) button while in manual circulation mode, the display changes in the order specified above, allowing you to lock on the current of a certain phase for focused management.

### **Button Switch Functions and Setting Sequence**


Mode	DN UP	Press the Up/Down buttons to find the function to set.		
Set	This mode indicates the start of the setting. When this button is pressed once, the corresponding value or character is times, during which you should continue the setting process. If there is no input for 30 seconds, it will be reset a have to press this button again to adjust the settings.			
Adjust	Press the Up/Down buttons to select the necessary value or characters.			
Store	Store  When the SET (store) button is pressed once, the selected value or characters are stored and the flickering same time.			
Reset Dutton is used to return to the initial state.  Once the setting is done, press the Reset button or leave it for 30 seconds to complete the setting.		Reset button is used to return to the initial state. Once the setting is done, press the Reset button or leave it for 30 seconds to complete the setting.		

#### \* Manual Circulation Display

- If you press the Set (Store) button during operation, the display of 3-phase current is switched from auto circulation display to manual circulation display.
- Once the original L1 phase is displayed, every time you press it, the phase display will change in the order of L2—L3—L1 phase. Press Reset to return to the auto circulation display state.

#### \* Trip Cause Check

• After pressing the Up/Down buttons to enter "Trip" Mode, press the Set/Store button once to display the last trip cause. Every time the Up button is pressed, the current at each phase (L1, L2, L3) at the time of the trip will be displayed. Press it once more to check the second-last trip cause. The method for checking subsequent fault causes and current during operation is the same as the one used for checking the last trip cause.

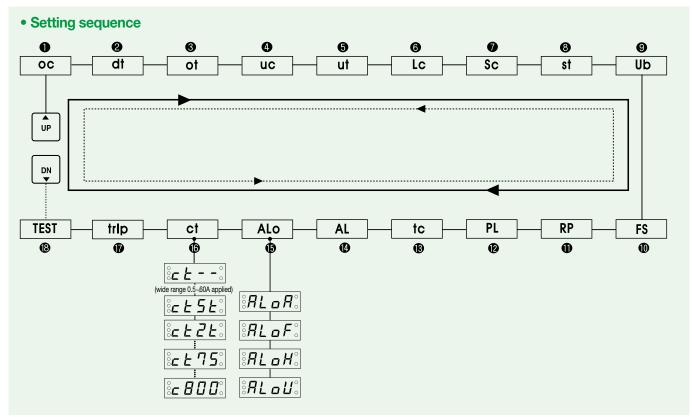

- Press the UP/Down buttons to find the Mode to set.
  To find ot in this figure, press the UP SW button 3 times if you are rotating the sequence of modes in a clockwise direction, then ot will appear in the display window.

# **Digital Over Current Relay**

# **Function Setting Sequence and Setting Menu**

Sequence	Settings	Display	Description	Setting Range	Default
1	Over Current Setting	o c 0.5°	Set your desired over current value. Set it higher (100%~125%) than the active load current (operating current). Current of 0.4A or higher can be displayed, but setting and operation are only available at the current of 0.5A or higher.  5.5~10A: Changes in increments of 0.1A, 10~60A: Changes in increments of 1A Cannot set to the UC set value or less. For Inverse, the setting cannot exceed 10A. When setting the CT Ratio, the protection set value converted based on the secondary CT (=primary active current/CT Ratio) must be set in "OC" Mode before setting the Ratio in "CT" Mode. Check the current value in "OC" Mode after setting the CT Ratio, and you will recognize that it is automatically converted to the active current value based on the primary CT.  Afterwards, the active current value can be changed to any value in the "OC" Mode for the identical CT ratio.	Current Setting Range Table	10
2	Start Delay Time Setting	de 1.0.	<ul> <li>This function stops the operation of start-up over current, under current, and lock functions. Must be set accurately.</li> <li>Phase loss and reverse phase still work normally during the set time period.</li> <li>1~100 sec: Changes in increments of 1 sec.</li> <li>100~200 sec: Changes in increments of 10 sec.</li> </ul>	• Can be set from 1~200 sec oFF (Mode display:)	10
3	Over Current Operation Time Setting	ob !.0.	Definite/Inverse can be selected and set in the tomode.  O.2~1 sec: Changes in increments of 0.1 sec.  1~30 sec: Changes in increments of 1 sec.	Can be set from 0.5~0.9-1sec (definite time)  Can be set from 1~30 sec (inverse time)	5
4	Under Current Setting	u c 0.5°	<ul> <li>Sets the preferred under current (light load current) value.</li> <li>Cannot be the same as OC set value or higher.</li> <li>0.5~10A: Changes in increments of 0.1A.</li> <li>10~59A: Changes in increments of 1A.</li> </ul>	Can be set from 0.5~59A oFF (Mode display:)	
5	Under Current Operation Time Setting	ut 1.0.	Sets the operation time of the relay for the set under current (light load).  Definite Operation  0.5~1 sec: Changes in increments of 0.1 sec.  1~30 sec: Changes in increments of 1 sec.	Can be set from 0.5~30 sec	
6	Lock (Stall) Current Setting: A multiple of OC set value.	Lc 7	Set as a multiple of over current set value.     Definite Operation     Operates within 0.5 sec if the current exceeds the set multiple value after dt.     Does not operate during operation.	0.5~10A: 2~10 times the over current setting     11A or higher: Automatically reduced to an appropriate multiple value. The upper value set for "Lc" is "[ Lc" upper value=100/OC set value], during which "Lc" can be changed to the range of upper value or below.     oFF (Mode display:)	10
7	Stall (heavy load during operation) or Shock (mechanical shock) Current Setting: A multiple of OC Set Value	5 c 2.0	Set to 1.5 times the over current set value. Definite Operation If the current flow exceeds the multiple of the SC set value due to heavy load during normal operation after startup, it will be tripped after the time set for St elapses.	O.5~10A: 1.5~5 times more 11A or higher: Automatically reduced to an appropriate multiple value. The upper value set for "Sc" is "[Sc" upper value=100"/OC" set value], during which "Sc" can be changed to the range of upper value or below.  OFF(Mode display:)	5
8	Stall Operation Time Setting	5 £ 5.0.	When Sc is set to oFF(), St is also automatically displayed as oFF().     Operates with the setting of 0.5 sec for shock protection	• 0.5, 1~10 sec oFF (Mode display:)	5
9	Current Unbalance Setting	ИЬ 10	<ul> <li>Sets the unbalance ratio of the phase current by the equation of [(Max. phase current - min. phase current)/ max. phase current] ×100)set %</li> </ul>	• 5~50% oFF (Mode display:)	50
10	Fail Safe (NVR) Function	FSon	Cannot be set while operating.	ON, OFF (Mode display:)	OFF

# **Digital Over Current Relay**

Sequence	Settings	Display	Description	Setting Range	Default
11	RPR (Reverse Phase Relay) Function	APon	Reverse phase function is disabled when set to oFF().	ON, oFF (Mode display:)	ON
12	Phase Loss Function Select	PLon	Can be set to oFF(). (Set to off for single-phase)	ON, oFF (Mode display:)	ON
13	Over Current Protection Operation Time Characteristics (select Definite/ Inverse)	EcdE	tc (Time-Current Characteristic): dE, In     Definite (dE): Operates based on operation characteristics on Table 1.     Inverse (In): Operates based on characteristics curve in Table 2.     When set to 11A or higher, dE is automatically applied.     Once Inverse (tdIn) is selected and operation delay time (dt) is set, hot curve will be applied after dt. When using inverse time for a longer startup time, it is possible to set faster operation time on overload during operation.	dE(definite), In(Inverse)     0.5~10A: Can select dE/In     11A or higher: dE is used (not when using external CT)	dE
14	Alert Rate Setting	AL 95	<ul> <li>Setting within the 90% range of OC set value is recommended.</li> <li>When selecting "U" from "ALO", "AL" is displayed as oFF().</li> </ul>	50%~100% of OC set value/oFF	100
15	Alert Output Format	AL o.A	Output Format  "A" (Ampere relay function): Energized upon current detection.  "F" (Flicker): Flickers.  "H" (Holding): ON-oFF output format  "U" (Under current Mode): AL output is converted to under current output.  Cannot be set while operating.	Output Format of 07-08 contact when the current exceeds the alert set value	A
16	CT Current Transformer Ratio Setting	c Ł 75	Automatically sets to the wide range (0.5~60A) mode if set to oFF().     Cannot set the CT scale while operating.     5t: Protectable at 0.12A or higher     2t: Protectable at 0.3A or higher     To set the CT Ratio, the target active current value for protection should be converted to the secondary value (=active current value/CT ratio), and the resulting value must first be set in "OC" Mode. (see the "OC" Mode setting guide for details)	OFF-5t, 2t, 10-15-25-30-40-50-60-75-100-120-150-200-250-300-400-500-600-750-800	
17	Trip Cause Check	Er IP	Displayed in the order of the Last-2nd Last-3rd Last trip. Trip causes and the current for each phase can be checked.	Can check from the 1st to the 3rd	
18	TEST Function	7E57.	7E57.  • 3 sec  • L 10.  • 10 sec  End	Does not convert to Test while operating. (to prevent tripping during operation)	

Inspection after installing EOCR should be performed as follows:

• Confirm that the wiring has been performed properly.

• Press the Down button once before starting the motor to show the Test display. 3 seconds after it is displayed, a countdown of the set of value will start. If End is

displayed after the countdown, it is normal.

• EOCR is designed to block the test function during operation to prevent unnecessary trip accidents.

• The Test function checks to ensure the health status of EOCR itself and the operational circuit after installing EOCR is normal.

### **Digital Over Current Relay**

#### **How to Set Current/Time**

#### Protects the motor by setting the current and time appropriately, as follows:

#### • Notes on Current Setting

- 1. Wide Range: If CT is set to --(oFF), it switches to the wide range. The range of working current can go up to 0.5A~60A for Definite (set to tcdE), and up to 0.5A~10A for Inverse (set to tcln).
  - \* You can select either Definite or Inverse if the OC set value is 10A or lower. However, if the OC set value is 10A or higher, the Inverse setting is not allowed. Similarly, OC set value cannot be 10A or higher when it is set to Inverse (tcln).

#### 2. External CT Combination

- CT ratio cannot be adjusted if OC (Over Current) set value is 6A or higher.
- CT setting sets the primary current value of an external CT. Once set, it is displayed as CT75 if the CT primary current is 75:5 or lower during the setting, and displayed as c100 if it is 100:5 or higher.
- The current range available when using an external CT is calculated as follows: CT ratio (i.e., 100:5=100/5=20)×0.5-6A=10-120A
- \*\* Once the current transformer ratio of CT is set, OC setting will not display the letter "c" in "OC"; instead, it will be displayed as o10.8 without the "c".
- Similarly, the under current setting will not display "c" of "UC" and will be displayed as u9.80, for example.
- Over Current Setting Sequence
- •Set the OC (Over Current) value to 6A or lower.
- •Set the CT ratio. The OC (Over Current) that is already set will be automatically converted to the value multiplied by the current transformer ratio of the CT (20 times if 100:5). For example, if OC is set at 4A and CT at 200, the over current setting is automatically set to 4×40=160A and saved.
- •Simply check the over current setting and set it appropriately for the load.

#### 3. Operation Time

- Definite: Set the time it takes for the current exceeding the set point to start to flow and trip the relay to ot.
- Inverse: Decide when the relay will be tripped in terms of after how much time has elapsed and after what multiple value of the set current flows with reference to the current-time characteristic curve, and complete the setting. Consider the figure below as an example. If ot is set to 5 and the current flow is 5 times the regular current, the relay will be tripped at 2 sec; if ot is set to 10, at 4 sec.


#### • Under Current Protection

- 1. It is more convenient to set to UC--(oFF) to prevent malfunction during startup for a test operation. Even during the test operation, it operates with no-load because the current flow is only one-third the rated current during no-load.
- 2. During normal operation, check the current in no-load state, and set the current to be slightly higher than the current in no-load state (to prevent no-load operation).
- 3. If under current function is unnecessary, the function is removed if set to UC--(oFF), and the over current operation time ut is removed as well.


## **Alert Operation Characteristics Table**

Load Status "ALo Setting"	Load Interruption	In Operation	Normal Operation	Operates at the Alert Set Value or a higher value	Trip
Aux"A"					
Flicker "F"				1 sec	
Hold "H"				1 sec	

- ALo"A": Ampere Relay function (energized and closed when current flows)
- ALo"F": Flickering function (closes when current flows and repeats closing and opening for the current equal to the AL set value or higher)
- ALo"H": ON~OFF Output Format function (closes at the AL set value or higher)
- ALo"U": AL output converts to "UC" (under current) output contact
- Output format and terminal configuration if ALo"A", ALo"F", or "ALo"H" is selected

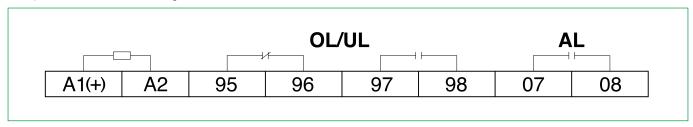

• Output terminal configuration if ALo"U" is selected: ALo function is not available, and is converted to the output for under current



## **Trip Cause Display and Check Method**

Displays all kinds of trip causes and fault current values on the digital display window, enabling easier maintenance and faster responses to accidents.


Trip Cause	Display	Description	Notes
Over Current	11	Detects over current at L1 (R) phase during operation and indicates operation.	
Under Current	L1	Detects under current at L2 (S) phase during operation and indicates operation.	
Phase Loss	11 12 13 Ano Sec	Indicates operation due to a phase loss at L2 (S) phase.	DN A UP
Reverse Phase	11 12 13 Amp Sec	Displays reverse phase trip.	Capable of checking the current for each phase by pressing the
Unbalance	L1 - L1 - Sec	Indicates that it operates due to a phase unbalance calculated by [(max. phase current-min. phase current) / max. phase current]×100>set %, and that min. current at the time is at L1 (R) phase.	switch after trip
Locked Rotor	11 12 13	Detects stall and indicates operation.	
Jam Trip During Operation	11 -5 - Ano sec	Displays trip due to stall or mechanical shock caused by heavy load at L3 (T) phase during operation.	

### **Digital Over Current Relay**


### **Example Wiring Diagram**

EOCR installation must be wired as shown below.

-Installation on either the frontal or rear part of the MC is allowed.

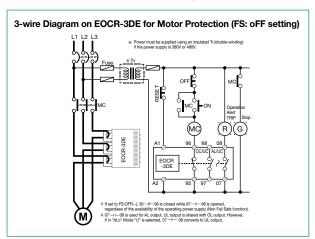


※ OL output 95 → F96 is opened and 97 → F98 is closed when FS is set to ON and operating power is supplied to A1 and A2

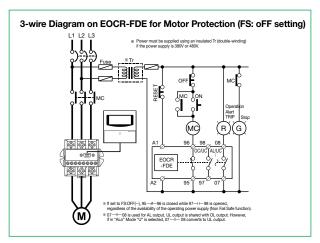

※ OL output 95→ F96 is opened and 97-| F98 is closed when FS is set to ON and operating power is supplied to A1 and A2.


# I/O Terminal Configuration

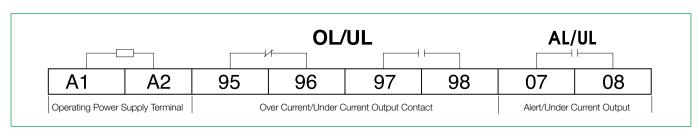


<sup>\*\*</sup> The operating power supply must be connected to operating power supply terminals (A1, A2) and the specified operating voltage should be applied.


## **Dimensions Diagram**





























MOUNTING HOLE SIZE









TYPE BRACKET HOLE SIZE

# **Digital Over Current Relay**

# **Ordering Specifications**

5.4	Reference		Current	Output	Operating P	ower Supply		N-t
Refe	rence		Range [A]	contact	Voltage [V]	Frequency [Hz]	Converter	Notes
		WRDB	Wide Range	b-a	DC/AC 24V	-	-	-
		H1DB	100:05:00	b-a	DC/AC 24V	-	-	CT Combination
		HHDB	150:05:00	b-a	DC/AC 24V	-	-	CT Combination
		H2DB	200:05:00	b-a	DC/AC 24V	-	-	CT Combination
		H3DB	300:05:00	b-a	DC/AC 24V	-	-	CT Combination
		H4DB	400:05:00	b-a	DC/AC 24V	-	-	CT Combination
		WRDF7	Wide Range	b-a	AC 110V	50/60	-	-
Section 1		H1DF7	100:05:00	b-a	AC 110V	50/60	-	CT Combination
2.50	EOCR3DE	HHDF7	150:05:00	b-a	AC 110V	50/60	-	CT Combination
	EUCH3DE	H2DF7	200:05:00	b-a	AC 110V	50/60	-	CT Combination
		H3DF7	300:05:00	b-a	AC 110V	50/60	-	CT Combination
		H4DF7	400:05:00	b-a	AC 110V	50/60	-	CT Combination
EOCR-3DE		WRDM7	Wide Range	b-a	AC 220V	50/60	-	-
		H1DM7	100:05:00	b-a	AC 220V	50/60	-	CT Combinatio
		HHDM7	150:05:00	b-a	AC 220V	50/60	-	CT Combinatio
		H2DM7	200:05:00	b-a	AC 220V	50/60	-	CT Combinatio
		H3DM7	300:05:00	b-a	AC 220V	50/60	-	CT Combinatio
		H4DM7	400:05:00	b-a	AC 220V	50/60	-	CT Combinatio
		WRDBW	Wide Range	b-a	DC/AC 24V	-	Window	-
		H1DBW	100:05:00	b-a	DC/AC 24V	-	Window	CT Combinatio
		HHDBW	150:05:00	b-a	DC/AC 24V	-	Window	CT Combinatio
		H2DBW	200:05:00	b-a	DC/AC 24V	-	Window	CT Combinatio
		H3DBW	300:05:00	b-a	DC/AC 24V	-	Window	CT Combinatio
		H4DBW	400:05:00	b-a	DC/AC 24V	-	Window	CT Combination
COL		WRDF7W	Wide Range	b-a	AC 110V	50/60	Window	-
alanana a		H1DF7W	100:05:00	b-a	AC 110V	50/60	Window	CT Combinatio
FOOD FDE (Hala Time)		HHDF7W	150:05:00	b-a	AC 110V	50/60	Window	CT Combinatio
EOCR-FDE (Hole Type)	FOODEDE	H2DF7W	200:05:00	b-a	AC 110V	50/60	Window	CT Combinatio
	EOCRFDE	H3DF7W	300:05:00	b-a	AC 110V	50/60	Window	CT Combinatio
		H4DF7W	400:05:00	b-a	AC 110V	50/60	Window	CT Combination
M250		WRDM7W	Wide Range	b-a	AC 220V	50/60	Window	
THE REAL PROPERTY AND ADDRESS OF THE PERTY		H1DM7W	100:05:00	b-a	AC 220V	50/60	Window	CT Combination
		HHDM7W	150:05:00	b-a	AC 220V	50/60	Window	CT Combinatio
EOCR-FDE (Terminal Type)		H2DM7W	200:05:00	b-a	AC 220V	50/60	Window	CT Combinatio
, ,,,		H3DM7W	300:05:00	b-a	AC 220V	50/60	Window	CT Combinatio
		H4DM7W	400:05:00	b-a	AC 220V	50/60	Window	CT Combination
		WRDBT	Wide Range	b-a	DC/AC 24V	-	Terminal	-
		WRDZ7T	Wide Range	b-a	DC/AC 85~250V	50/60	Terminal	-

Accessory 1							
	Reference	PIN Type	Length (M)				
	CABLE-15-00H	15PIN	0.5				
	CABLE-15-001	15PIN	1				
	CABLE-15-01H	15PIN	1.5				
Cable	CABLE-15-002	15PIN	2				
	CABLE-15-003	15PIN	3				
	:	:	1				
	CABLE-15-010	15PIN	10				

# **Digital Over Current Relay**

### **How to Order**


### To order an EOCR-3DE:



			• •
		WR	0.5~60A
		H1	100:5 3CT Combination Type
0	Current Range	НН	150:5 3CT Combination Type
		H2	200:5 3CT Combination Type
		Н3	300:5 3CT Combination Type
		H4	400:5 3CT Combination Type
0	Output Contact State	D	b(95-96)-a(97-98)
69 '	On a wating a Passage Street	В	AC/DC24V Compatible
	Operating Power Supply/	F7	AC110V, 50/60Hz
	Frequency	M7	AC220V, 50/60Hz

<sup>\*\*</sup> For a CT combination type, please write an accessory code from the CT Order Codes separately.

#### To order a cable:



0	Cable Connection Specification	15PIN		
		00H	0.5M	
		1	1M	
	Cable Length	01H	1.5M	
0		2	2M	
		3	3M	
		:	:	
		10	10M	

#### To order an EOCR-FDE:

Ε	O C R F D	Ε	W R D Z 7 W
			0 0 0 0
0	Current Range	WR	0.5~60A
		H1	100:5 3CT Combination Type
		НН	150:5 3CT Combination Type
		H2	200:5 3CT Combination Type
		Н3	300:5 3CT Combination Type
		H4	400:5 3CT Combination Type
0	Output Contact State	D	b(95-96)-a(97-98)
8	Operating Power Supply/ Frequency	В	AC/DC24V Compatible
		F7	AC110V, 50/60Hz
		M7	AC220V, 50/60Hz
		<b>Z</b> 7	AC/DC85~250V, 50/60Hz
4	Converter	W	Window (Hole Type)
		Т	Terminal (Terminal Type)

<sup>\*\*</sup> For a CT combination type, please write an accessory code from the CT Order Codes separately.

<sup>\*\*</sup> For cables, please write an appropriate code for the required length when ordering a main body.